


STANDARD LEGEND

⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
┌┐	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
⌌	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T.	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable

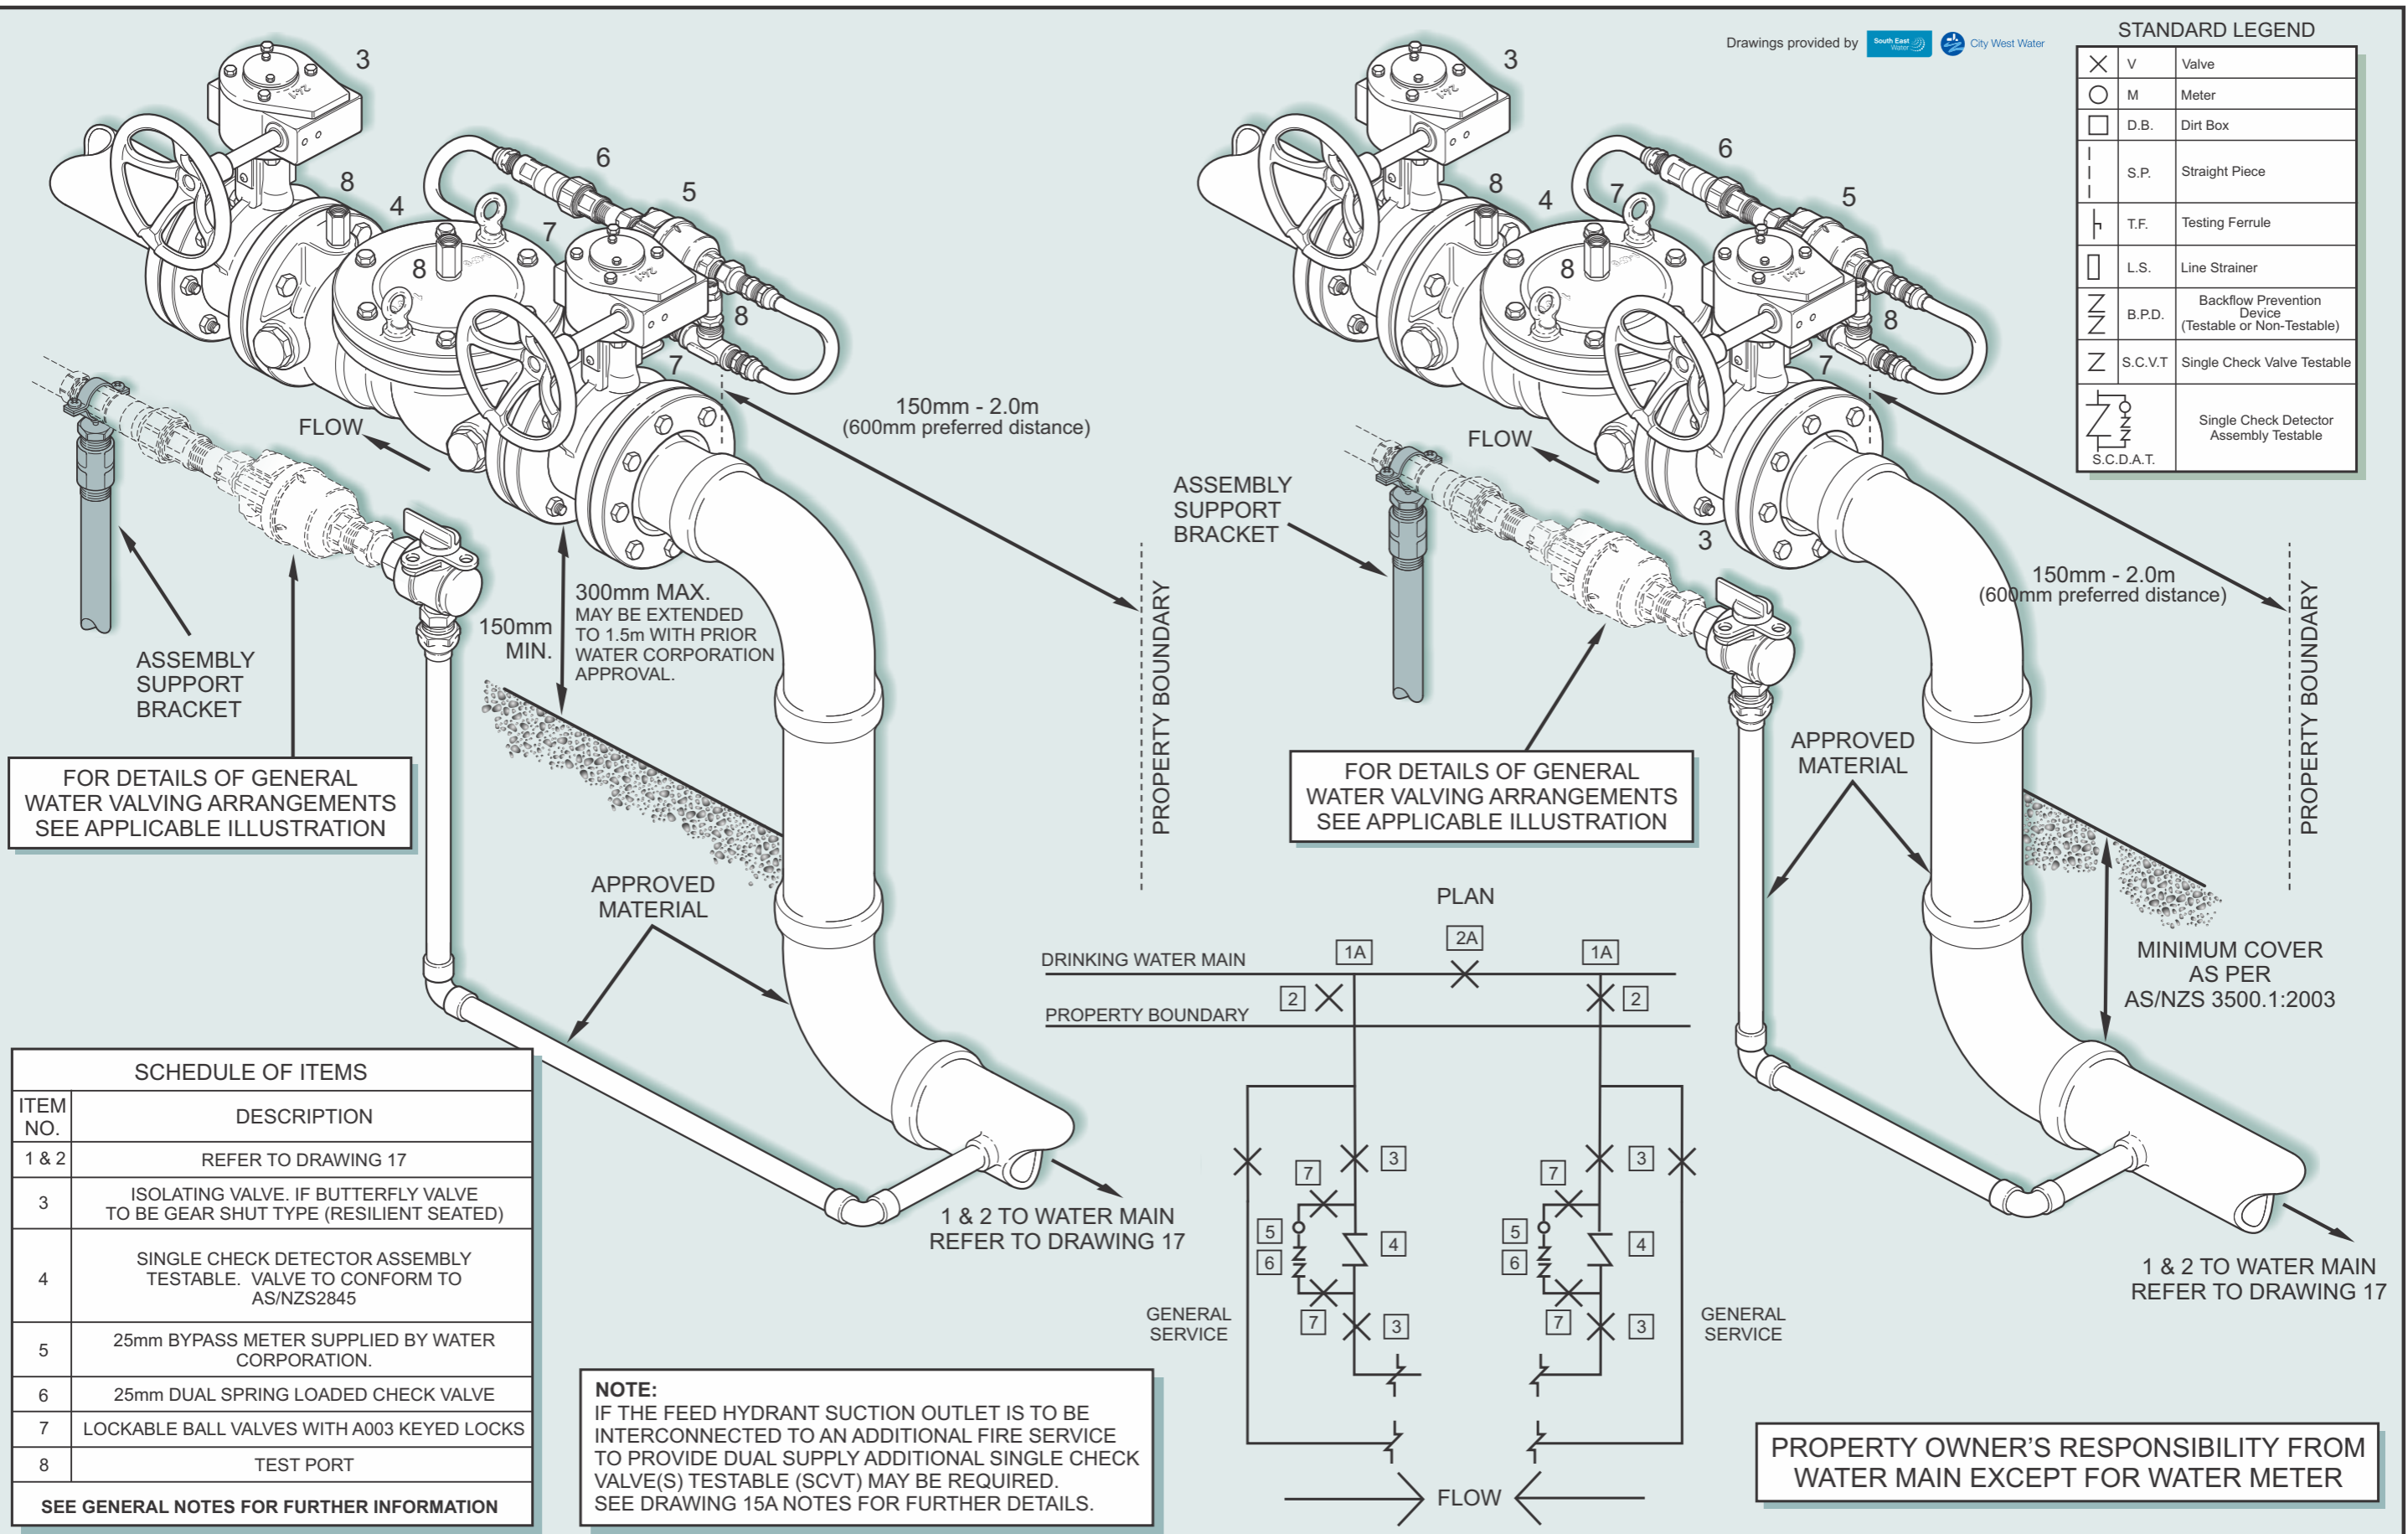

FOR DETAILS OF GENERAL WATER VALVING ARRANGEMENTS SEE APPLICABLE ILLUSTRATION

FOR DETAILS OF GENERAL WATER VALVING ARRANGEMENTS SEE APPLICABLE ILLUSTRATION

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	SINGLE CHECK DETECTOR ASSEMBLY TESTABLE. VALVE TO CONFORM TO AS/NZS2845
5	25mm BYPASS METER SUPPLIED BY WATER CORPORATION.
6	25mm DUAL SPRING LOADED CHECK VALVE
7	LOCKABLE BALL VALVES WITH A003 KEYED LOCKS
8	TEST PORT
SEE GENERAL NOTES FOR FURTHER INFORMATION	

NOTE:
IF THE FEED HYDRANT SUCTION OUTLET IS TO BE INTERCONNECTED TO AN ADDITIONAL FIRE SERVICE TO PROVIDE DUAL SUPPLY ADDITIONAL SINGLE CHECK VALVE(S) TESTABLE (SCVT) MAY BE REQUIRED. SEE DRAWING 15A NOTES FOR FURTHER DETAILS.

PROPERTY OWNER'S RESPONSIBILITY FROM WATER MAIN EXCEPT FOR WATER METER