




**STANDARD 150mm KERB & GUTTER**

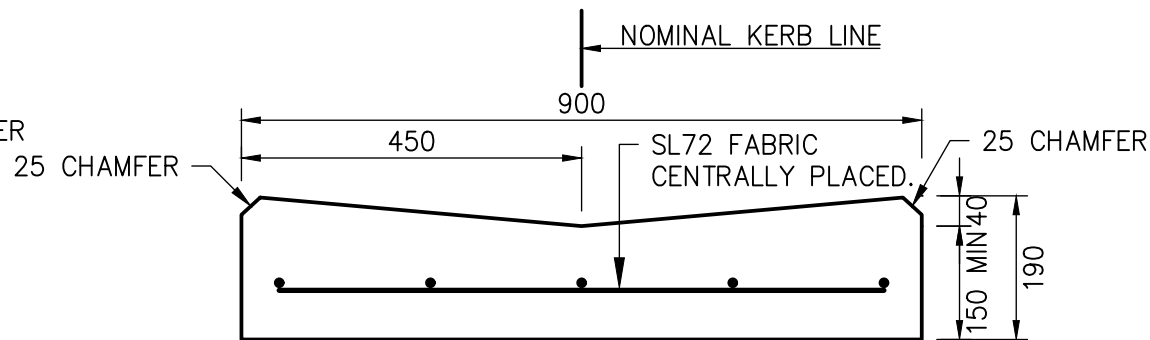


**REINFORCED DISH CROSSING  
(AT ROAD JUNCTIONS 32MPa)**

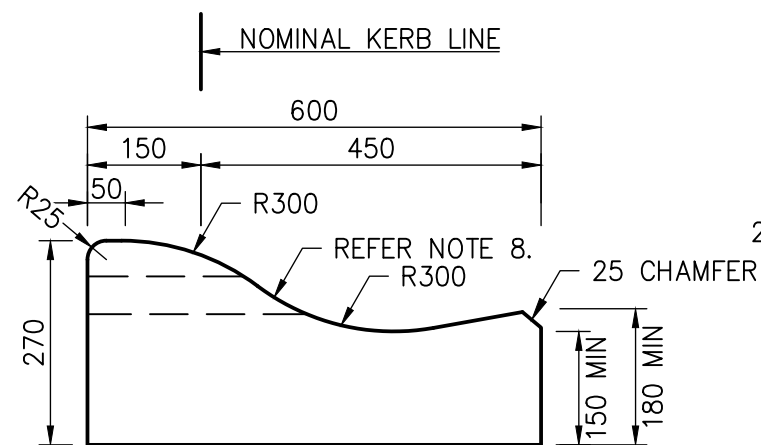


**ROLL KERB & GUTTER**

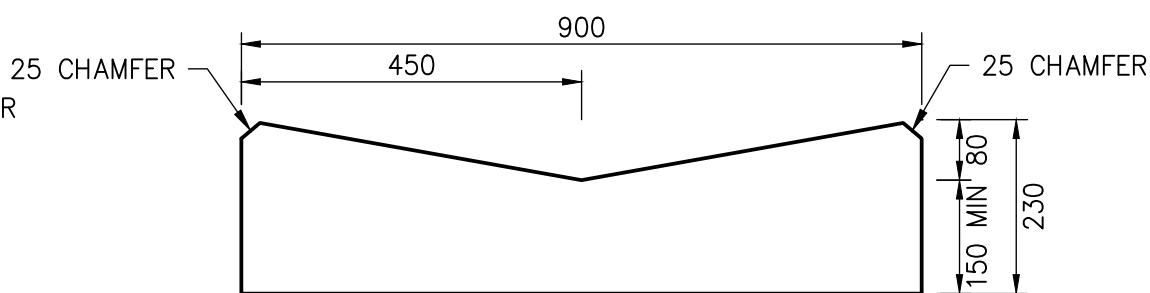

**LOW FLOW 'V' DRAIN**

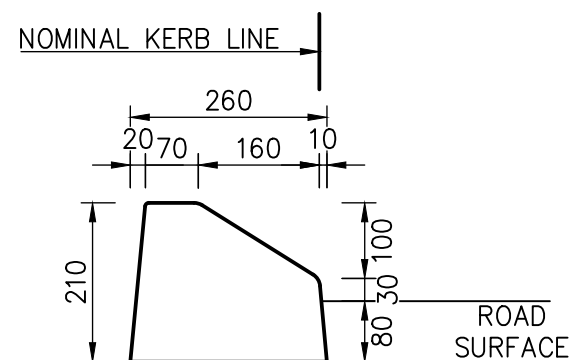

**RAISED MEDIANS & TRAFFIC ISLANDS  
(RMS TYPE SF)**

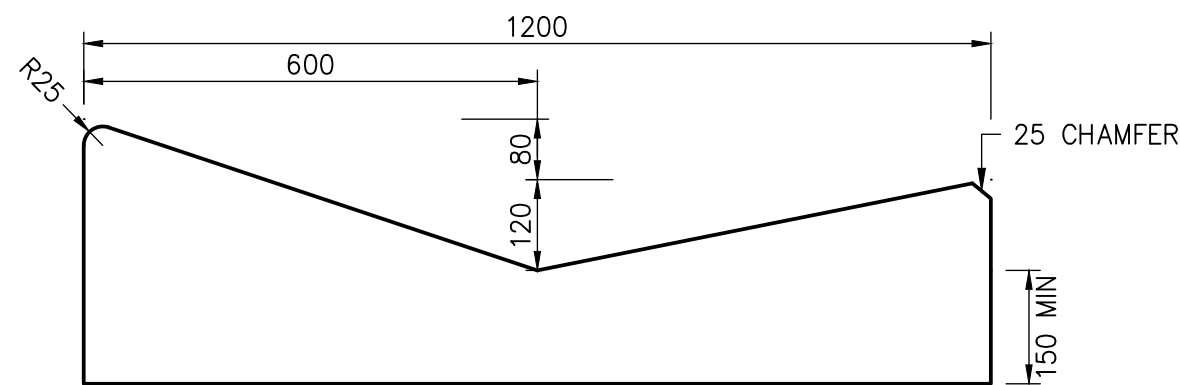

**GUTTER ADJACENT TO CUTTINGS  
(RMS TYPE SK)**

**NOTES:**

1. ALL WORK IS TO BE CARRIED OUT TO COUNCILS DESIGN AND CONSTRUCTION SPECIFICATION.
2. KERB AND GUTTERS SHALL BE PLACED ON A COMPACTED DGB20 BASE COURSE, MINIMUM 150 THICK, TO EXTEND 150 BEYOND THE REAR FACE OF KERBS, GUTTERS, AND CROSSINGS ON SUB-GRADE COMPACTED TO 98% MODIFIED COMPACTION.
3. CONCRETE TO BE OF 25MPa EXTRUDED OR 32MPa FORMED COMPRESSIVE STRENGTH AT 28 DAYS, EXCEPT WHERE NOTED OTHERWISE.
4. FOR UNREINFORCED CONCRETE, PROVIDE CONTRACTION JOINT 50% OF CROSS SECTION AT 2.5 TO 3m SPACING. WHEN REINFORCED, CONTRACTION JOINTS SHALL BE 25mm DEEP ONLY.
5. REINFORCING FABRIC TO BE AS/NZS 4671 HARD-DRAWN STEEL WIRE.
6. WHERE CONDUITS ARE REQUIRED TO BE PLACED PRIOR TO KERB CONSTRUCTION, KERB FACES SHALL BE MARKED FOR LOCATION WITH AN APPROVED TOOL, OR AS DIRECTED BY THE SUPERINTENDING OFFICER.
7. FORTY EIGHT (48) HOURS NOTICE IS TO BE GIVEN PRIOR TO THE PLACING OF CONCRETE TO ALLOW FOR INSPECTION BY COUNCIL'S OFFICER.
8. PROVIDE 50x150x2mm GALVANISED STEEL STORMWATER OUTLETS AND CONVERT TO ROOF WATER PIPES WITH PROPRIETARY ADAPTOR.

B	CONCRETE STRENGTH	TZ	25/01/21
A	REVISED DRAWING	TZ	25/01/21
ISSUE	AMENDMENTS	DRAWN	DATE



DRAWN .....TZ  
SCALE .....1:10  
SHEET SIZE: **A3**

APPROVED  
*[Signature]*  
GROUP MANAGER  
INFRASTRUCTURE SERVICES  
D.L.

<b>WINGECARRIBEE SHIRE COUNCIL</b>			
<b>STANDARD DRAWING KERB AND GUTTER SHAPES</b>			
DATE: 25/01/2021	PLAN No: SD102	SHEET 1 OF 1	ISSUE <b>B</b>